



Curb Ramp Inspection Form

Must be filled out for every ramp constructed in City right-of-way in the City of Rancho Cordova. This form must be filled out and submitted within ten days of ramp construction to the ADA Program Access Coordinator.

Curb Ramp Location:

N/E N/W S/E S/W

Project Name: _____

N/S STREET _____

E/W STREET _____

Curb Ramps per City Standard Drawing 4-23 & 4-24:

Vertical Curb Rolled curb

Check One:

One Ramp Two Ramps

STANDARDS:

- NO POLES OR PULLBOXES SHALL BE LOCATED IN RAMPS
- ALL ELEMENTS, EXCEPT GUTTERS AND RETAINING CURBS, MUST BE CONSTRUCTED PLANAR IN NATURE, WITH WEAKENED PLANED JOINTS SCORED BETWEEN EACH ELEMENT.
- PAN MUST BE WITHIN STRIPED CROSSWALKS

A1: _____ B1: _____ C1: _____ D1: _____

A2: _____ B2: _____ C2: _____ D2: _____

A3: _____ B3: _____ C3: _____ D3: _____

RIGHT SIDE LENGTH: _____ FT. _____ IN.

PAN WIDTH: _____ FT. _____ IN.

LEFT SIDE LENGTH: _____ FT. _____ IN.

IF TWO RAMPS ON CORNER (DATA FOR 2ND RAMP):

E1: _____ F1: _____ G1: _____ H1: _____

E2: _____ F2: _____ G2: _____ H2: _____


E3: _____ F3: _____ G3: _____ H3: _____

RIGHT SIDE LENGTH: _____ FT. _____ IN.

PAN WIDTH: _____ FT. _____ IN.

LEFT SIDE LENGTH: _____ FT. _____ IN.

DISTANCE BETW. RAMPS: _____ FT. _____ IN.

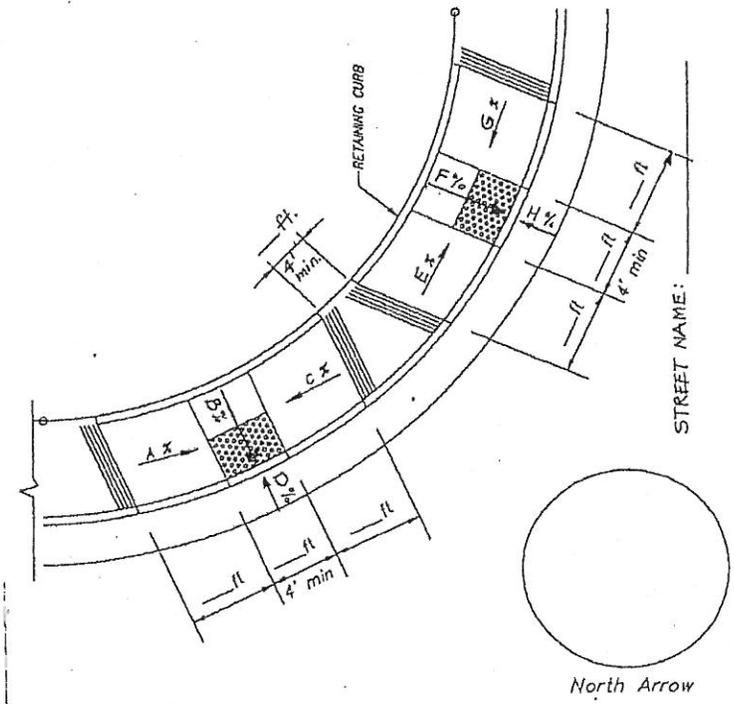

STREET NAME: _____

North Arrow

Inspected/measured by (print): _____ Date Field Measured: _____

Directions:

Three measurements for all data shall be taken at the ramps and pans, one measurement shall be taken at the centerline of the element and the other two shall be taken 18 inches on either side of the first measurement for the element. None of the three recorded measurements of any element may exceed the limits indicated above.

See reverse side for Compliance with Standards.



Sidewalk Inspection Form

Must be filled out for every sidewalk constructed in City right-of-way in the City of Rancho Cordova. This form must be filled out and submitted within ten days of construction to the ADA Program Access Coordinator.

Street: _____ Project Name: _____

Sides of Street:

N E S W

Nearest Cross-Streets:

STREET _____ STREET _____

Sidewalks per City Standard Drawing 4-25:

Check all that apply:

Vertical Curb Rolled curb No Curb Planter strip entire length Partial length planter strip

STANDARDS:

- CLEAR WIDTH AT LEAST 48" (NOT INCLUDING CURB) OR AT LEAST 36" AT AN OBSTRUCTION
- NO OVERHEAD OBSTRUCTIONS LOWER THAN 84".
- CROSS-SLOPE 1.5%. RUNNING SLOPE NOT GREATER THAN STREET OR 5%, WHICHEVER IS GREATER.
- NO GAPS WIDER THAN 1/2".
- SURFACE CONCRETE OR ASPHALT, BROOM FINISH OR EQUAL SLIP-RESISTANCE.
- NO DROP-OFF GREATER THAN 4" AT BACK OR AT PLANTER STRIP.

NORTH OR EAST CROSS-STREET _____

NORTH OR WEST SIDE OF STREET:

SIDEWALK CLEAR WIDTH: A1: _____ FT. _____ IN.
 A2: _____ FT. _____ IN.
 A3: _____ FT. _____ IN.

PLANTER STRIP WIDTH: B: _____ FT. _____ IN.
 (PUT "0" IF NO PLANTER STRIP)

RUNNING SLOPE: C1: _____ % C2: _____ % C3: _____ %

CROSS-SLOPE: D1: _____ % D2: _____ % D3: _____ %

OTHER SPECIFIC CONDITIONS: _____

SOUTH OR EAST SIDE OF STREET:

SIDEWALK CLEAR WIDTH: E1: _____ FT. _____ IN.
 E2: _____ FT. _____ IN.
 E3: _____ FT. _____ IN.


PLANTER STRIP WIDTH: F: _____ FT. _____ IN.
 (PUT "0" IF NO PLANTER STRIP)

RUNNING SLOPE: G1: _____ % G2: _____ % G3: _____ %

CROSS-SLOPE: H1: _____ % H2: _____ % H3: _____ %

OTHER SPECIFIC CONDITIONS: _____

DRAW ALL OBSTRUCTIONS OR HAZARDS ON THE PLAN:

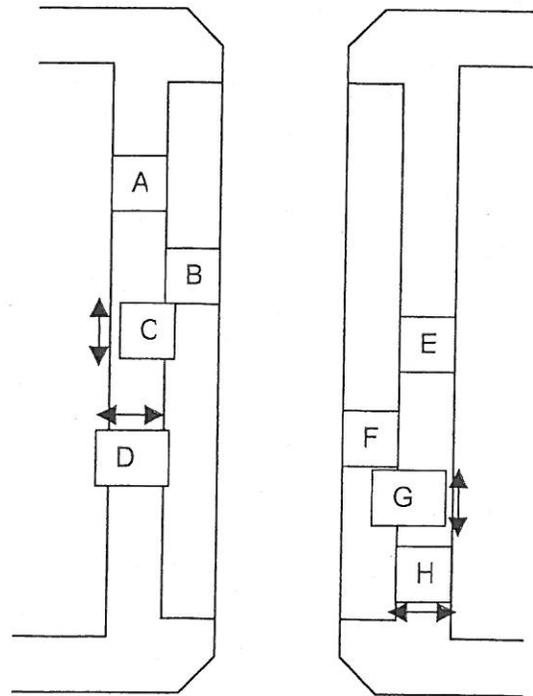

SOUTH OR EAST CROSS-STREET _____

Inspected/measured by (print): _____ Date Field Measured: _____

Directions: Three measurements shall be taken at various locations along the sidewalk. None of the three recorded measurements may exceed the limits indicated above. See reverse side for Compliance with Standards.



Pedestrian Signal Inspection Form

Must be filled out for all new pedestrian signals installed in City right-of-way. This form must be filled out and submitted within ten days of signal installation to the City ADA Program Access Coordinator.

Pedestrian Signal Location:

Project Name: _____

N/E N/W S/E S/W

N/S STREET _____

E/W STREET _____

Pedestrian Signals per City Standard Drawings:

Check One:

Vertical Curb Rolled curb One Ramp Two Ramps

STANDARDS:

- EACH PUSH BUTTON LOCATED WITHIN 60" OF EXTENDED CROSSWALK LINE, AND 120" FROM OTHER BUTTONS.
- EACH PUSH BUTTON LOCATED 120" MAX. AND 30" MIN. FROM CURB LINE.
- PUSH BUTTON PARALLEL TO DIRECTION OF CROSSING.
- CLEAR SURFACE SPACE OF 30" X 48" AT PUSH BUTTON.
- HEIGHT TO C.L. OF PUSH BUTTON FROM 42" TO 46" MAX.
- MAX. 5 LBS. OF PRESSURE TO OPERATE.
- LOCATOR TONE FROM 2 DB TO 5 DB, & ABOVE AMBIENT.

IF ONE PUSH BUTTON IS PRESENT:


A:

HEIGHT OF PUSH BUTTON (IN.): _____
 DIAMETER OF PUSH BUTTON (IN.): _____
 ACCESSIBLE SIGNAL OPERATIONAL (Y/N): _____
 LOCATOR TONE OPERATIONAL (Y/N): _____
 PUSH BUTTON PARALLEL TO DIRECTION (Y/N): _____

IF TWO PUSH BUTTONS ARE PRESENT:

B:

HEIGHT OF PUSH BUTTON (IN.): _____
 DIAMETER OF PUSH BUTTON (IN.): _____
 ACCESSIBLE SIGNAL OPERATIONAL (Y/N): _____
 LOCATOR TONE OPERATIONAL (Y/N): _____
 PUSH BUTTON PARALLEL TO DIRECTION (Y/N): _____

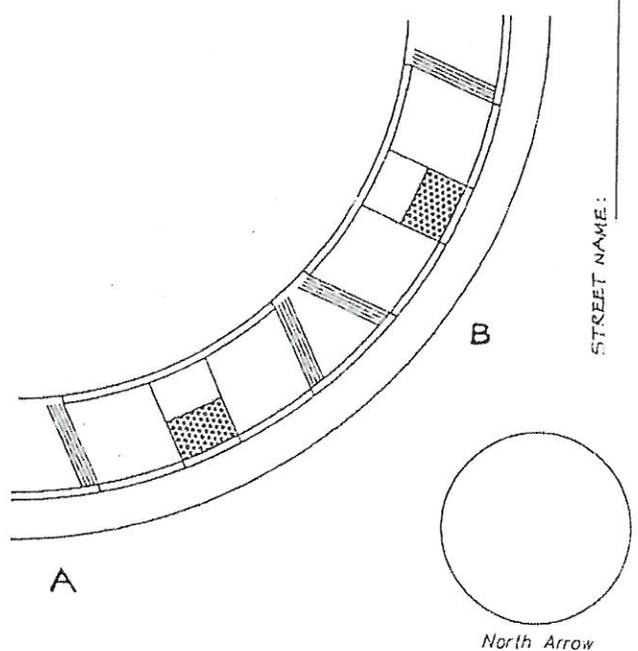

STREET NAME: _____

ANY CONDITIONS NOT IN COMPLIANCE WITH THE STANDARDS LISTED ABOVE _____

DRAW LOCATION OF PUSH BUTTON(S) AT THE PROPER LOCATION (IF ONLY ONE RAMP, DRAW BUTTON LOCATION ON RAMP A)

Inspected/measured by (print): _____

Date Field Measured: _____

See reverse side for Compliance with Standards.